
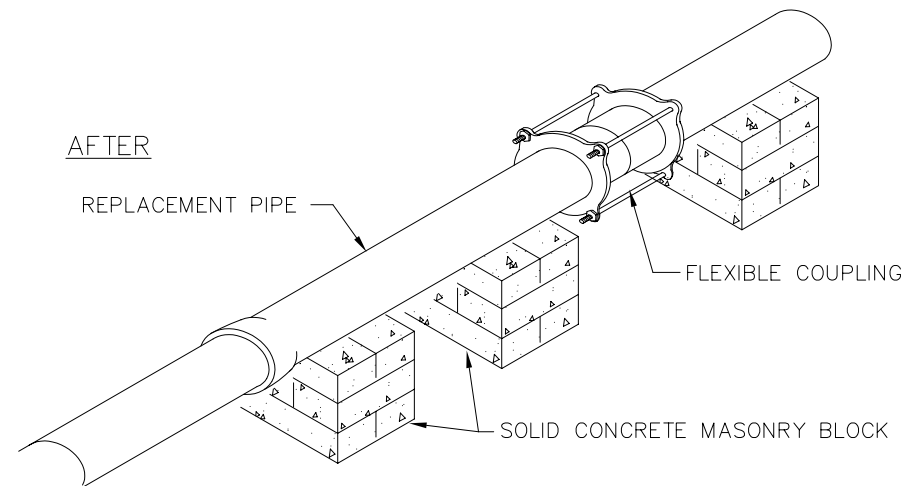


NOTES

1. REPLACE PIPE MATERIAL SHALL BE IN KIND OR DUCTILE IRON.
2. WHERE POSSIBLE, ONE END OF THE REPLACEMENT PIPE SECTION SHALL CONNECT TO AN EXISTING BELL OR SPIGOT.
3. FLEXIBLE COUPLING SHALL BE THE CAST IRON TYPE AND SPECIFICALLY DESIGNED FOR USE ON THE PIPE SIZE AND MATERIAL(S) BEING CONNECTED. USE OF FULL CIRCLE REPAIR CLAMPS IS PROHIBITED.
4. THE NEW REPLACEMENT PIPE SECTION SHALL BE ADEQUATELY DRY BLOCKED PRIOR TO BACKFILLING.
5. BACKFILLING SHALL NOT BEGIN UNTIL LINE PRESSURE IS RESTORED AND CONNECTIONS INSPECTED FOR LEAKAGE BY WATER DEPARTMENT PERSONNEL.
6. DRY BLOCKS SHALL BE STANDARD SIZE SOLID MASONRY CONCRETE BLOCKS. (ASTM C-139)
7. REPLACEMENT PIPE SHALL BE CLEANED IN ACCORDANCE WITH SECTION 611.1.

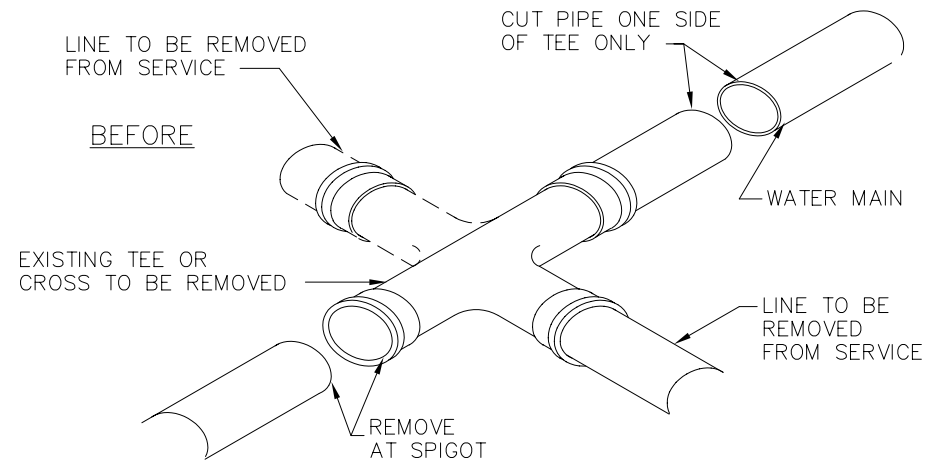

DETAIL NO.
G-3303

CITY OF GOODYEAR
STANDARD DETAIL

APPROVED BY:
Goodyear Standards and
Policies Committee 7/97

WATERLINE CUT OUT (TEES & CROSSES)
FOR 12" DIA. MAIN AND SMALLER

DETAIL NO.
G-3303